

# MARWELL CORPORATION

Manufacturer of UL Listed Meter Socket Adapters

WWW.MARWELLCORP.COM

PO BOX 139 MENTONE CA 92359

(909) 794-4192 FAX (909) 794-0250

## 2000 Series A-Base to Socket

### 2000 Series

12 Standard Models Detailed Below and on next page **Inquire about specials.**

**DEAD FRONT OPTION AVAILABLE**


### C/UL LISTED

Rated for Indoor or Outdoor Application.  
Threaded inserts for "Banjo Box" meter base.  
Grounding system standard on all models.

Tamper indicator on terminal cover, sealable retaining screw.  
**UL Listed**, proprietary blend, fiberglass reinforced polycarbonate housing. All **UL Listed** Self-Contained units rated 125A Continuous - 150A Maximum

All **UL Listed** CT Rated units rated 30A Continuous  
300V US - 240V Canada Rated





Optionally rated for 200A Max service at 160A Continuous.

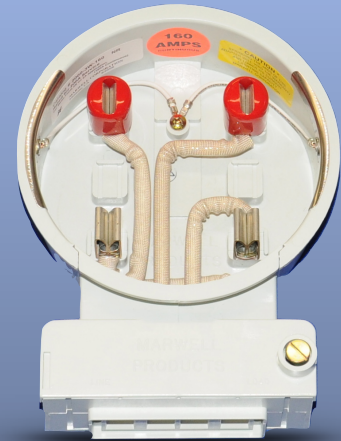

2000-3W-160-NR SHOWN



**INDOOR AND OUTDOOR RATED**

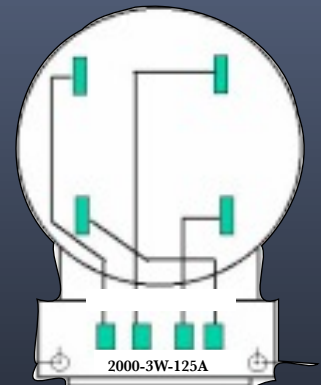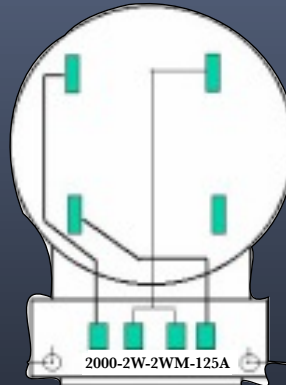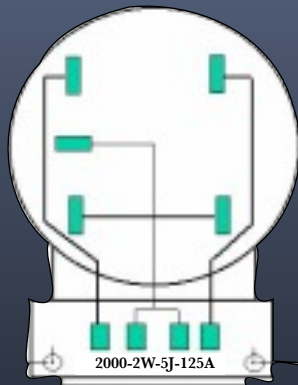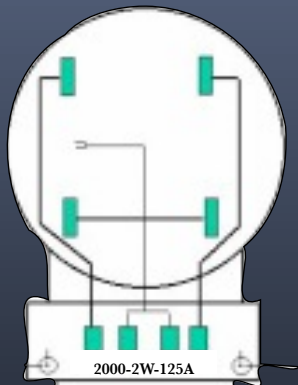

<u>MODEL</u>	<u>SERVICE</u>	<u>METER</u>	<u>TERMINALS</u>	<u>JAWS</u>
2000-2W-125A	2 WIRE	3 WIRE	4	4
	<b>NOTE: #16 AWG WIRE, POTENTIAL LINK TO TERMINAL BLOCK.</b>			
2000-2W-5J-125A	2 WIRE	3 WIRE	4	5
	<b>NOTE: #12 AWG WIRE, 5TH JAW TO NEUTRAL JUMPER.</b>			
2000-2W-2WM-125A	2 WIRE	2 WIRE	4	3
	<b>NOTE: #12 AWG WIRE, UPPER RIGHT JAW TO NEUTRAL JUMPER.</b>			
2000-3W-125A	3 WIRE	3 WIRE	4	4
	2 WIRE	2 WIRE	4	4



Consult Factory for Pricing and Availability.

# MARWELL CORPORATION

Manufacturer of UL Listed Meter Socket Adapters



WWW.MARWELLCORP.COM

PO BOX 139 MENTONE CA 92359

(909) 794-4192 FAX (909) 794-0250

## 2000 Series A-Base to Socket C/UL LISTED

### 2000 Series Circuit Drawings

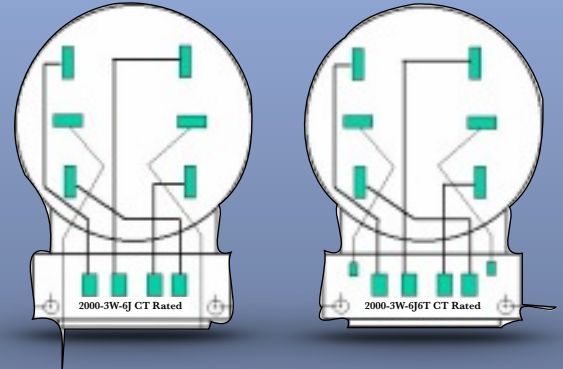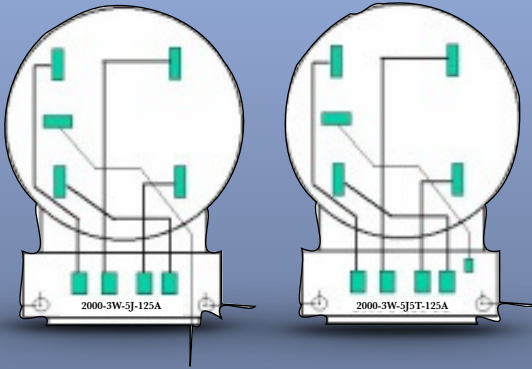



<u>MODEL</u>	<u>SERVICE</u>	<u>METER</u>	<u>TERMINALS</u>	<u>JAWS</u>
2000-3W-5J-125A	3 WIRE	3 WIRE	4	5
<b>NOTE:</b> #12 STRANDED WIRE, 5TH JAW THROUGH TERMINAL BLOCK.				
2000-3W-5J5T-125A	3 WIRE	3 WIRE	5	5
<b>NOTE:</b> #12 SOLID COPPER WIRE, 5TH JAW TO 5TH TERMINAL IN TERMINAL BLOCK.				
2000-3W-6J CT Rated	3 WIRE	3 WIRE	4	6
<b>NOTE:</b> #12 STRANDED WIRE, 5TH & 6TH JAW THROUGH TERMINAL BLOCK.				
2000-3W-6J6T CT Rated	3 WIRE	3 WIRE	6	6
<b>NOTE:</b> #12 SOLID COPPER WIRE, 5TH & 6TH JAW TO TERMINALS IN TERMINAL BLOCK.				

### OPTIONS

-160 RATED FOR 200A SERVICE AT 160 AMP CONTINUOUS CURRENT RATING.

- LG LESS GROUND, OMIT SURGE GROUND STRAPS.

- DS DEEP STOPS, EXTRA DEEP WIRE STOPS, 5/8 INCH DEEPER THAN NORMAL.

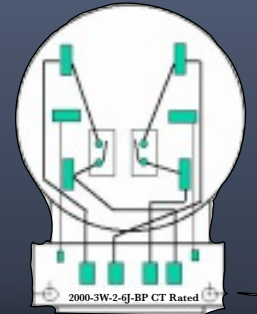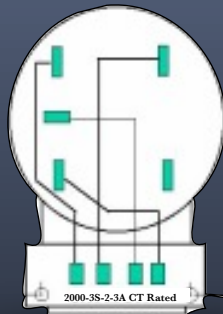

<u>MODEL</u>	<u>SERVICE</u>	<u>METER</u>	<u>TERMINALS</u>	<u>JAWS</u>
2000-3S-2-3A CT Rated	2 WIRE	2 WIRE	4	5
<b>NOTE:</b> 3S TO 3A TRANSFORMER RATED.				
2000-3S-2-3A-BP CT Rated	2 WIRE	2 WIRE	4	5
<b>NOTE:</b> 3S TO 3A TRANSFORMER RATED WITH AUTOMATIC CURRENT BYPASS.				
2000-3W-2-6J-BP CT Rated	3 WIRE	3 WIRE	6	6
<b>NOTE:</b> 3W TO 6J TRANSFORMER RATED WITH AUTOMATIC CURRENT BYPASS.				
2000-3W-2-6J6T-BP CT Rated	3 WIRE	3 WIRE	6	6
<b>NOTE:</b> 3W TO 6J TRANSFORMER RATED WITH AUTOMATIC CURRENT BYPASS.				



Consult Factory for Pricing and Availability.